



SEDGWICK COUNTY, KANSAS
DIVISION OF FINANCE
Purchasing Department
525 N. Main, Suite 823 ~ Wichita, KS 67203
Phone: 316 660-7255 Fax: 316 383-7055

<http://sedgwickcounty.org/finance/purchasing.asp>

REQUEST FOR BID
ADDENDUM #1
#16-0049
AUDIO VISUAL EQUIPMENT AND INSTALLATION

May 18, 2016

Clarification-Summary of Project

A Smart Board with integrated projector will be removed from the present location and reinstalled at the new office designated by the owner.

The equipment list provided will be the new equipment installed at the new conference room. This will be integrated with the present camera system which will be relocated and installed by the city. Two audio outputs need to be provided for local media connection as well as recording capability. The present conference room audio system will remain. This consists of speakers, amps, microphones, DSP.

Please see the three (3) attachments included with this addendum:

Office drawings-new location

Electrical drawings-new location

Specifications of existing video system which **MUST** integrate with the system that is bid

Vendors are responsible for checking the website and **acknowledging any addenda on the Bid Response Form.**

Kimberly Evans
Purchasing Agent

HD/SD-SDI HDD Recorder HDR-70

4:2:2 COLOUR SAMPLING



HDR-70 is a 2.5" hard disk video recorder and player, with a removable drive enclosure. The HDR-70 records in standard and high definition video equipment via SDI, with a convenient loop thru output. RS-422 and 232 remote control interfaces are standard.

HDR-70 supports 1080p, 1080i, 720p, 576i, 480i video formats and

provides a choice of recording in MPEG-II Long-GOP or intra-frame (i-frame) with 4:2:2 color sampling. The recorded MXF/OP1A file format is compatible with a wide range of NLE and play out systems.

Once recording is complete, connect hard drive in its caddy to a PC or MAC based NLE system via USB 2.0, (no extra power supply required).

You can work directly from the removable drive, or copy files across to the computer's video drives.

The compact 1RU 19 inch rack-mountable design can be easily integrated with other equipment in a studio control room, recording room, on an OB truck. They are compatible with Datavideo's PPU systems.

FEATURES

- HD/SD-SDI HDD Recorder with two removable HDD Enclosure for SATA HDD/SSD solid state device
- Video resolutions:
 - 1920x1080 50i/59.94i/60i, 1920x1080 24p/23.96p
 - 1280x720 50P/59.94P/60P
 - 720x576i or 720x480i
- Support NTFS format, no 2GB/4GB file limitation
- HD/SDI input, output and loop thru with embedded audio
- HDMI output with embedded audio
- 2-CH balanced audio inputs, support embedded Audio
- 2-CH balanced audio outputs
- Audio level indicators, earphone interface for audio monitoring with volume control
- External Gen-Lock input and loop thru (B.B or tri-level)
- Time code(TC) input and loop thru
- RS-232/422 and GPI remote interface
- SD mode recording:
 - Selectable 8, 15, 30 or 50 Mbps Long GOP 4:2:0 or 4:2:2
 - 25 or 50 Mbps i-frame only 8-bit 4:2:2
- HD mode recording:
 - Selectable 10, 25, 35, 65 or 100 Mbps Long GOP 4:2:0 or 4:2:2
 - 100/125 Mbps i-frame 8-bit 4:2:2
- Recording file formats: MXF/OP1A, MOV quick time* (*. MOV quick time by future firmware upgrade)
- Power: DC 12 Volt, 16 watt

FRONT VIEW



REAR VIEW





- ELECTRICAL NOTES:**
- ELECTRICAL CONTRACTOR TO DISCONNECT, CAP, ANY CIRCUIT SUPPLYING RECEPTACLES DEVICES WITH-IN ANY WALLS TO BE REMOVED PRIOR TO DEMOLITION.
 - ALL RECEPTACLE DEVICES IN EXTERIOR WALLS SHALL REMAIN, RETAIN CIRCUIT CONTINUITY AFTER DEMOLITION.
 - "IT ROOM": REMOVE ALL DATA CABLING AND VERIFY WHICH EXISTING DATA RACKS ARE TO BE REUSED.
 - DISCONNECT AND REMOVE EXISTING WALL SCONCES, CAP WIRES, AND PROVIDE BLANK COVER PLATE FOR WALL BOX.

SYMBOL DEVICE SCHEDULE

SYM	DESCRIPTION
▽B	BLANK 2" X 4" OUTLET
▽1	ONE DEVICE IN SINGLE BOX
▽2	TWO DEVICES IN SINGLE BOX
▽3	THREE DEVICES IN SINGLE BOX
▽4	FOUR DEVICES IN SINGLE BOX
▽D	DATA OUTLET IN SINGLE BOX
△P	ACCESS PANEL
◇	TV OUTLET IN SINGLE BOX
⌘	SINGLE POLE SWITCH
⊞	MOTION SENSOR IN SWITCH BOX
⊞	DUPLEX RECEPTACLE
⊞	4-FLX RECEPTACLE
⊞	GFCI RECEPTACLE
⊞	WALL MOUNTED SENSOR

VOICE / DATA DEMOLITION NOTE:
 CONTRACTOR SHALL REMOVE ALL VOICE / DATA CABLING BACK TO EXISTING "IT" ROOM AND RACKS. ALL CABLING REMOVED SHALL BE REMOVED FROM SITE. ALL UNDERFLOOR RACKWAYS SHALL BE CLEAN OF ANY EXISTING LOW VOLTAGE COMMUNICATION CABLES. CONTRACTOR MAY REUSE THIS RACKWAY TO ROUTE NEW CABLING TO EXISTING LOCATIONS WHERE NEW DEVICES ARE SHOWN. ALL UN-USED BOXES, AFTER NEW CABLING IS INSTALLED SHALL HAVE BLACK COVER PLATED FURNISHED AND INSTALLED.

EXISTING UNDER FLOOR DUCT ACTIVATIONS ARE NOT INDICATED. CONTRACTOR SHALL REMOVE ALL PHONE DATA CABLES WITH-IN FLOOR DUCT SYSTEM BACK TO TERMINAL BOARDS IN "IT" ROOM. RETURN ALL UN-USED POWER CONNECTIONS, PARTS AND ACCESSORIES TO OWNER AFTER DEMOLITION.

DISCONNECT AND REMOVE ALL UN-USED VOICE AND DATA CABLING ABOVE CEILING DURING DEMOLITION.

ANY SPECIAL SYSTEM NOT USED WITH-IN AREA SHALL BE REMOVED BACK TO POINT OF SUPPLY. VERIFY WITH OWNER.

EXISTING POWER DEVICES IN AREA, NOT BEING REMOVED DURING DEMO, ARE NOT SHOWN AND SHALL REMAIN. MAINTAIN CIRCUIT CONTINUITY AFTER DEMOLITION.

LEVEL 2 - DEMOLITION PLAN - POWER
 SCALE: 1/8" = 1'-0"



ENGINEUNITY
 Consulting Engineers
 335 N. Meade
 Wichita, KS 67202
 Phone: (316) 235-7959
 Fax: (316) 235-7997

SEDGWICK COUNTY
 271 W. 3RD ST. BUILDING
 WICHITA, KANSAS 67202

©2015
 Schaefer Johnson Cox Frey Architecture, Inc.
 All Rights Reserved.
 These drawings and their contents, including, but not limited to, all concepts, designs, plans, specifications, and any other information, are the exclusive property of Schaefer Johnson Cox Frey (SJCF), and may not be used or reproduced in any way without the express consent of SJCF.

Revisions

△	△
△	△
△	△
△	△

Project Number
SJCF 0000.00

Date
01-26-16

**LEVEL 2
 DEMOLITION PLAN
 POWER**

1/8" = 1'-0"

E2.DP



A LEVEL 2 - NEW CONSTRUCTION PLAN - POWER
 SCALE: 1/8" = 1'-0"
 NORTH

EXISTING RECEPTACLES TO REMAIN ARE NOT SHOWN.
 MAINTAIN CONTINUITY OF CIRCUIT, AFTER DEMOLITION.

SYMBOL LIST		
SYMBOL	DESCRIPTION	MOUNTING
(A)	FLUORESCENT FIXTURE 4 FIXTURE LETTER	CEILING
(B)	FLUORESCENT FIXTURE 4 FIXTURE LETTER	SUSPENDED
(C)	SWITCHES (1-POLE, 3-WAY, 4-WAY, PILOT, ETC)	4'-0" TO TOP
(D)	DUPLEX GROUNDED RECEPTACLE	1'-3" AFF
(E)	EXIT FIXT. - SHADING DENOTES FACE(S)	CEIL./MALL
(F)	SPECIAL OUTLET, SEE SCHEDULE OR AS NOTED	
(G)	JUNCTION BOX	
(H)	WALL MOUNTED EMERGENCY LIGHT	SURFACE
(I)	SPECIAL DEVICE AS NOTED ON PLAN	
(J)	BRANCH CIRCUIT PANEL 4 PANEL DESIG.	6'-6" TO TOP
(K)	CONDUIT RUN 2 #12 4 #12 GRD-1/2"	CEIL./MALL
(L)	CONDUIT RUN 2 CIRCUITS #12 4 #12 GRD-1/2"	EARTH/FLOOR
(M)	PARTIAL HOMERUN (MULTIPLE LOAD LOCATIONS)	
(N)	KEY NOTE IDENTIFICATION, SEE SCHEDULE	
(O)	TELEPHONE JACK WITH NUMBER OF JACKS	
(P)	DATA OUTLET WITH NUMBER OF JACKS	
(Q)	GFCI DUPLEX GROUNDED RECEPTACLE	1'-3" AFF
(R)	FIRE ALARM SPEAKER	RECESS / CEILING

SPECIAL OUTLET SCHEDULE	
SYMBOL	DESCRIPTION
(A)	POWER 4 DATA ACTIVATION POINT IN UNDER FLOOR DUCT. IF EXISTING ACCESS POINT IS AVAILABLE, REUSE IN LIEU OF NEW ACTIVATION

CONTRACTOR SHALL MARK THE EXACT LOCATION OF THE UNDER FLOOR DUCT SYSTEM SO NO DAMAGE WILL OCCUR WHEN INSTALLING ANY NEW WALLS.

MODULAR FURNITURE IS CONNECTED TO POWER AND DATA VIA WHIPS PROVIDED WITH FURNITURE. I.E. TO VERIFY WITH SUPPLIER PRIOR TO ROUGH-IN.

- ### GENERAL NOTES
- CONTRACTOR SHALL DISCONNECT, REMOVE EXISTING FIXTURES, INSTALL NEW FIXTURES AT EXISTING LOCATIONS UNLESS NOTED OTHERWISE. CONTRACTOR SHALL RECONNECT ANY NEW FIXTURES TO EXISTING SPECIAL WIRING, NIGHT LIGHTS, BATTERY BALLAST, ETC AS REQUIRED TO MAINTAIN EXISTING CONDITIONS. CONTRACTOR TO CONNECT TO EXISTING CIRCUITS WITHIN ROOM. EXISTING CIRCUITS MAYBE HARD WIRED BETWEEN FIXTURES. CONTRACTOR SHALL REPAIR AND CONNECT NEW FIXTURES AS REQUIRED. INSTALL JCT. BOXES AND USE FLEX WIRING TO EACH FIXTURE. DO NOT DAISY CHAIN FIXTURES TOGETHER. CONTRACTOR IS RESPONSIBLE TO VERIFY CONDITIONS AT SITE PRIOR TO BIDDING.
 - CONTRACTOR SHALL REMOVE FROM SITE ALL EXISTING REMOVED FIXTURES, LAMPS AND BALLAST AND DISPOSE OF ITEMS AS REQUIRED BY ANY GOVERNING BODIES. AFTER REMOVAL FROM ROOMS OWNER HAS FIRST RIGHT TO SALVAGE PRIOR TO CONTRACTOR REMOVING ITEMS FROM SITE.
 - WHERE CEILING FANS OCCUR WITHIN ROOMS, CONTRACTOR SHALL RECONNECT CEILING FANS WIRING SIMILAR TO EXISTING. REPAIRS, CONDUITS OR WIREMOLD AS REQUIRED.
 - WHERE SPECIAL WIRING, PROJECTOR CORDS, CABLE, ETC ARE ATTACHED TO CEILING, AND ARE IN THE WAY OF NEW FIXTURE INSTALLATION, CONTRACTOR SHALL REMOVE AND REATTACHED BACK TO EXISTING CONDITION. THESE CABLES SHALL NOT BE DAMAGED.
 - WHERE EXISTING INCANDESCENT CAN FIXTURES ARE REMOVED AND REPLACED WITH NEW FLUORESCENT FIXTURES, CONTRACTOR SHALL DISC. POWER FROM EXISTING FIXTURE AND EXTEND POWER TO NEW FIXTURE. EXISTING RECESSED CAN HOUSING CAN REMAIN ABOVE CEILING AND NOT COMPLETELY REMOVED.
 - AS THE ELECTRICAL CONTRACTOR IS INSTALLING OR MODIFYING ELECTRICAL WIRING FOR THIS PROJECT AND NOTES A CODE VIOLATION OR OTHER ITEMS NOT MEETING N.E.C. CODES, HE SHALL NOTIFY ARCHITECT IN WRITING AND NOTE LOCATION ON DRAWINGS SO CORRECTIONS COULD BE MADE BY THE CONTRACTOR OR THE OWNER'S PERSONAL PRIOR TO COMPLETION OF WORK. THIS WILL ALSO INCLUDE OPEN JCT. BOXES.
 - MOTION SENSORS ARE CONNECT AHEAD OF ANY SWITCHES, AND SHALL BE CONTROL MAIN CIRCUIT SUPPLYING FIXTURES WITHIN ROOM OR SPACE. WHERE MORE THAN ONE SENSOR IS INDICATED WITHIN ROOM, SENSORS SHALL BE CONNECTED TOGETHER TO ACT AS ONE UNIT. SENSORS SHALL NOT CONTROL ANY HOTS SUPPLYING ANY EXIT OR EMERGENCY LIGHTS WITHIN SPACE. WHERE MULTIPLE UNITS ARE INDICATED WITHIN CORRIDOR, THEY SHALL BE EQUALLY SPACED OR LOCATED AT QUARTER POINTS WITHIN ROOMS OR SPACE - POWER FAC REQUIRED WHERE MULTIPLE CIRCUITS ARE REQUIRED.
 - DAYLIGHT SENSORS ARE CONNECT AHEAD OF ANY SWITCHES, AND SHALL BE CONTROL MAIN CIRCUIT SUPPLYING FIXTURES WITHIN ROOM OR SPACE. WHERE MORE THAN ONE SENSOR IS INDICATED WITHIN ROOM, SENSORS SHALL BE CONNECTED TOGETHER TO ACT AS ONE UNIT. SENSORS SHALL NOT CONTROL ANY HOTS SUPPLYING ANY EXIT OR EMERGENCY LIGHTS WITHIN SPACE. WHERE MULTIPLE UNITS ARE INDICATED WITHIN CORRIDOR, THEY SHALL BE EQUALLY SPACED OR LOCATED AT QUARTER POINTS WITHIN ROOMS OR SPACE - POWER FAC REQUIRED WHERE MULTIPLE CIRCUITS ARE REQUIRED. LOCATE TO CONTROL FIXTURES NEXT TO DAYLIGHT SOURCE AND MANUFACTURER'S INSTRUCTION.
 - WHERE EXISTING CONDUIT IS MOUNTED SURFACE SUPPLYING LIGHTING FIXTURE, MOTION SENSORS SHALL BE MOUNTED ON SURFACE BOX AND CONDUIT ROUTED ON SURFACES. ALL EXPOSED CONDUITS SHALL BE PAINTED TO MATCH SURROUNDING SURFACES, WHERE ITEMS IN AREA ARE FINISHED.

POWER CIRCUIT NOTES:

- TO EXISTING CIRCUIT OR CIRCUITS IN AREA. CONTRACTOR TO VERIFY.
- TO NEW 20A/1P CIRCUIT BREAKER IN EXISTING PANEL.
- VERIFY ANY CONNECTION POWER / DATA REQUIREMENTS AT RECEPTION DESK.



ENGINEUNITY
 Consulting Engineers
 335 N. Meaco, Suite 100
 Wichita, KS 67202
 Phone: (316) 238-7999
 Fax: (316) 238-7997

SEDGWICK COUNTY
 271 W. 3RD ST. BUILDING
 WICHITA, KANSAS 67202

©2015
 Schaefer Johnson Cox Frey Architecture, Inc.
 All Rights Reserved.
 These drawings and their contents, including, but not limited to, all concepts, designs, ideas are the exclusive property of Schaefer Johnson Cox Frey (SJCF), and may not be used or reproduced in any way without the express consent of SJCF.


Revisions	
△	△
△	△
△	△
△	△

Project Number
SJCF 0000.00

Date
01-26-16

LEVEL 2
 NEW CONSTRUCTION
 PLAN - POWER
 1/8" = 1'-0"

E2.1

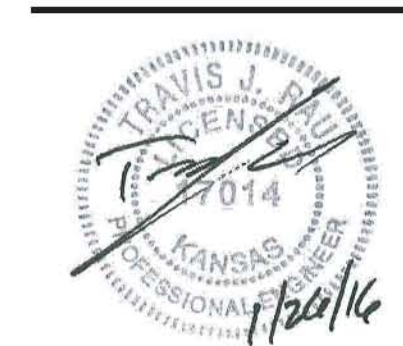

ENGINEITY
Consulting Engineers
335 N. Mead
Wichita, KS 67203
Phone: (316) 258-7996
Fax: (316) 258-7997

SEDGWICK COUNTY
271 W. 3RD ST. BUILDING
WICHITA, KANSAS 67202

©2016
Scheffer Johnson Cox Frey Architecture, Inc.
All Rights Reserved
These drawings and their contents, including, but not limited to, all concepts, designs, & ideas are the exclusive property of Scheffer Johnson Cox Frey (SJCF), and may not be used or reproduced in any way without the express consent of SJCF.

Revisions

△	△
△	△
△	△
△	△

Project Number
SJCF 0000.00

Date
01/26/16

LEVEL 2
NEW CONSTRUCTION
PLAN - LIGHTING
1/8" = 1'-0"

E2.2

LIGHTING FIXTURE SCHEDULE

SYM	DESCRIPTION	LAMP		MOUNTING	NOTES
		TYPE	CODE		
A	NEW 2' X 4' RECESSED LENSED TROFFER TO MATCH EXISTING	-	-	RECESS / CEILING	-
B	NEW 2' X 2' RECESSED LENSED TROFFER TO MATCH EXISTING	-	-	RECESS / CEILING	-
E	EXISTING RECESSED LIGHT FIXTURE TO REMAIN	-	-	RECESS / CEILING	-
R	EXISTING 2' X 4' RECESSED LENSED TROFFER TO BE RELOCATED	-	-	RECESS / CEILING	-
⊕ ¹	EXISTING EXIT LIGHT (WITH BATTERY BACK-UP)	LED	INCLUDED	CEILING/VARIABLE	2
⊕ ²	NEW EXIT LIGHT (WITH BATTERY BACK-UP)	LED	INCLUDED	CEILING/VARIABLE	2
⊕ ³	EXISTING EMERGENCY LIGHT (WITH BATTERY BACK-UP)	HALOGEN	INCLUDED	7'-6" A.F.F.	2
⊕ ⁴	NEW EMERGENCY LIGHT (WITH BATTERY BACK-UP)	HALOGEN	INCLUDED	7'-6" A.F.F.	2


NOTES:

- GENERAL CONTRACTOR SHALL PROVIDE FIREPROOFING AROUND ANY RECESSED LIGHT FIXTURE INSTALLED IN A FIRE RATED CEILING PER U.L. REQUIREMENTS. ELECTRICAL CONTRACTOR SHALL COORDINATE.
- EXIT AND EMERGENCY LIGHTS TO BE CONNECTED TO CIRCUIT AS NOTED, UN-SWITCHED

- LIGHTING NOTES:**
- EXISTING LIGHTING IN THIS AREA SHALL REMAIN AS IS, UNLESS OTHERWISE NOTED.
 - CONNECT TO THE EXISTING LIGHTING CIRCUIT IN THE AREA AND CONTROL WITH THE EXISTING LIGHTING.
 - CONNECT TO THE EXISTING LIGHTING CIRCUIT IN THE AREA AND CONTROL FROM SWITCH AS SHOWN.
 - FURNISH AND INSTALL A NEW TYPE 'A' FIXTURE IN THE EXISTING CORRIDOR LAY-IN CEILING. CONNECT TO THE EXISTING LIGHTING CIRCUIT IN THE AREA AND CONTROL WITH EXISTING LIGHTING.



A LEVEL 2 - NEW CONSTRUCTION PLAN - LIGHTING
SCALE: 1/8" = 1'-0"
NORTH

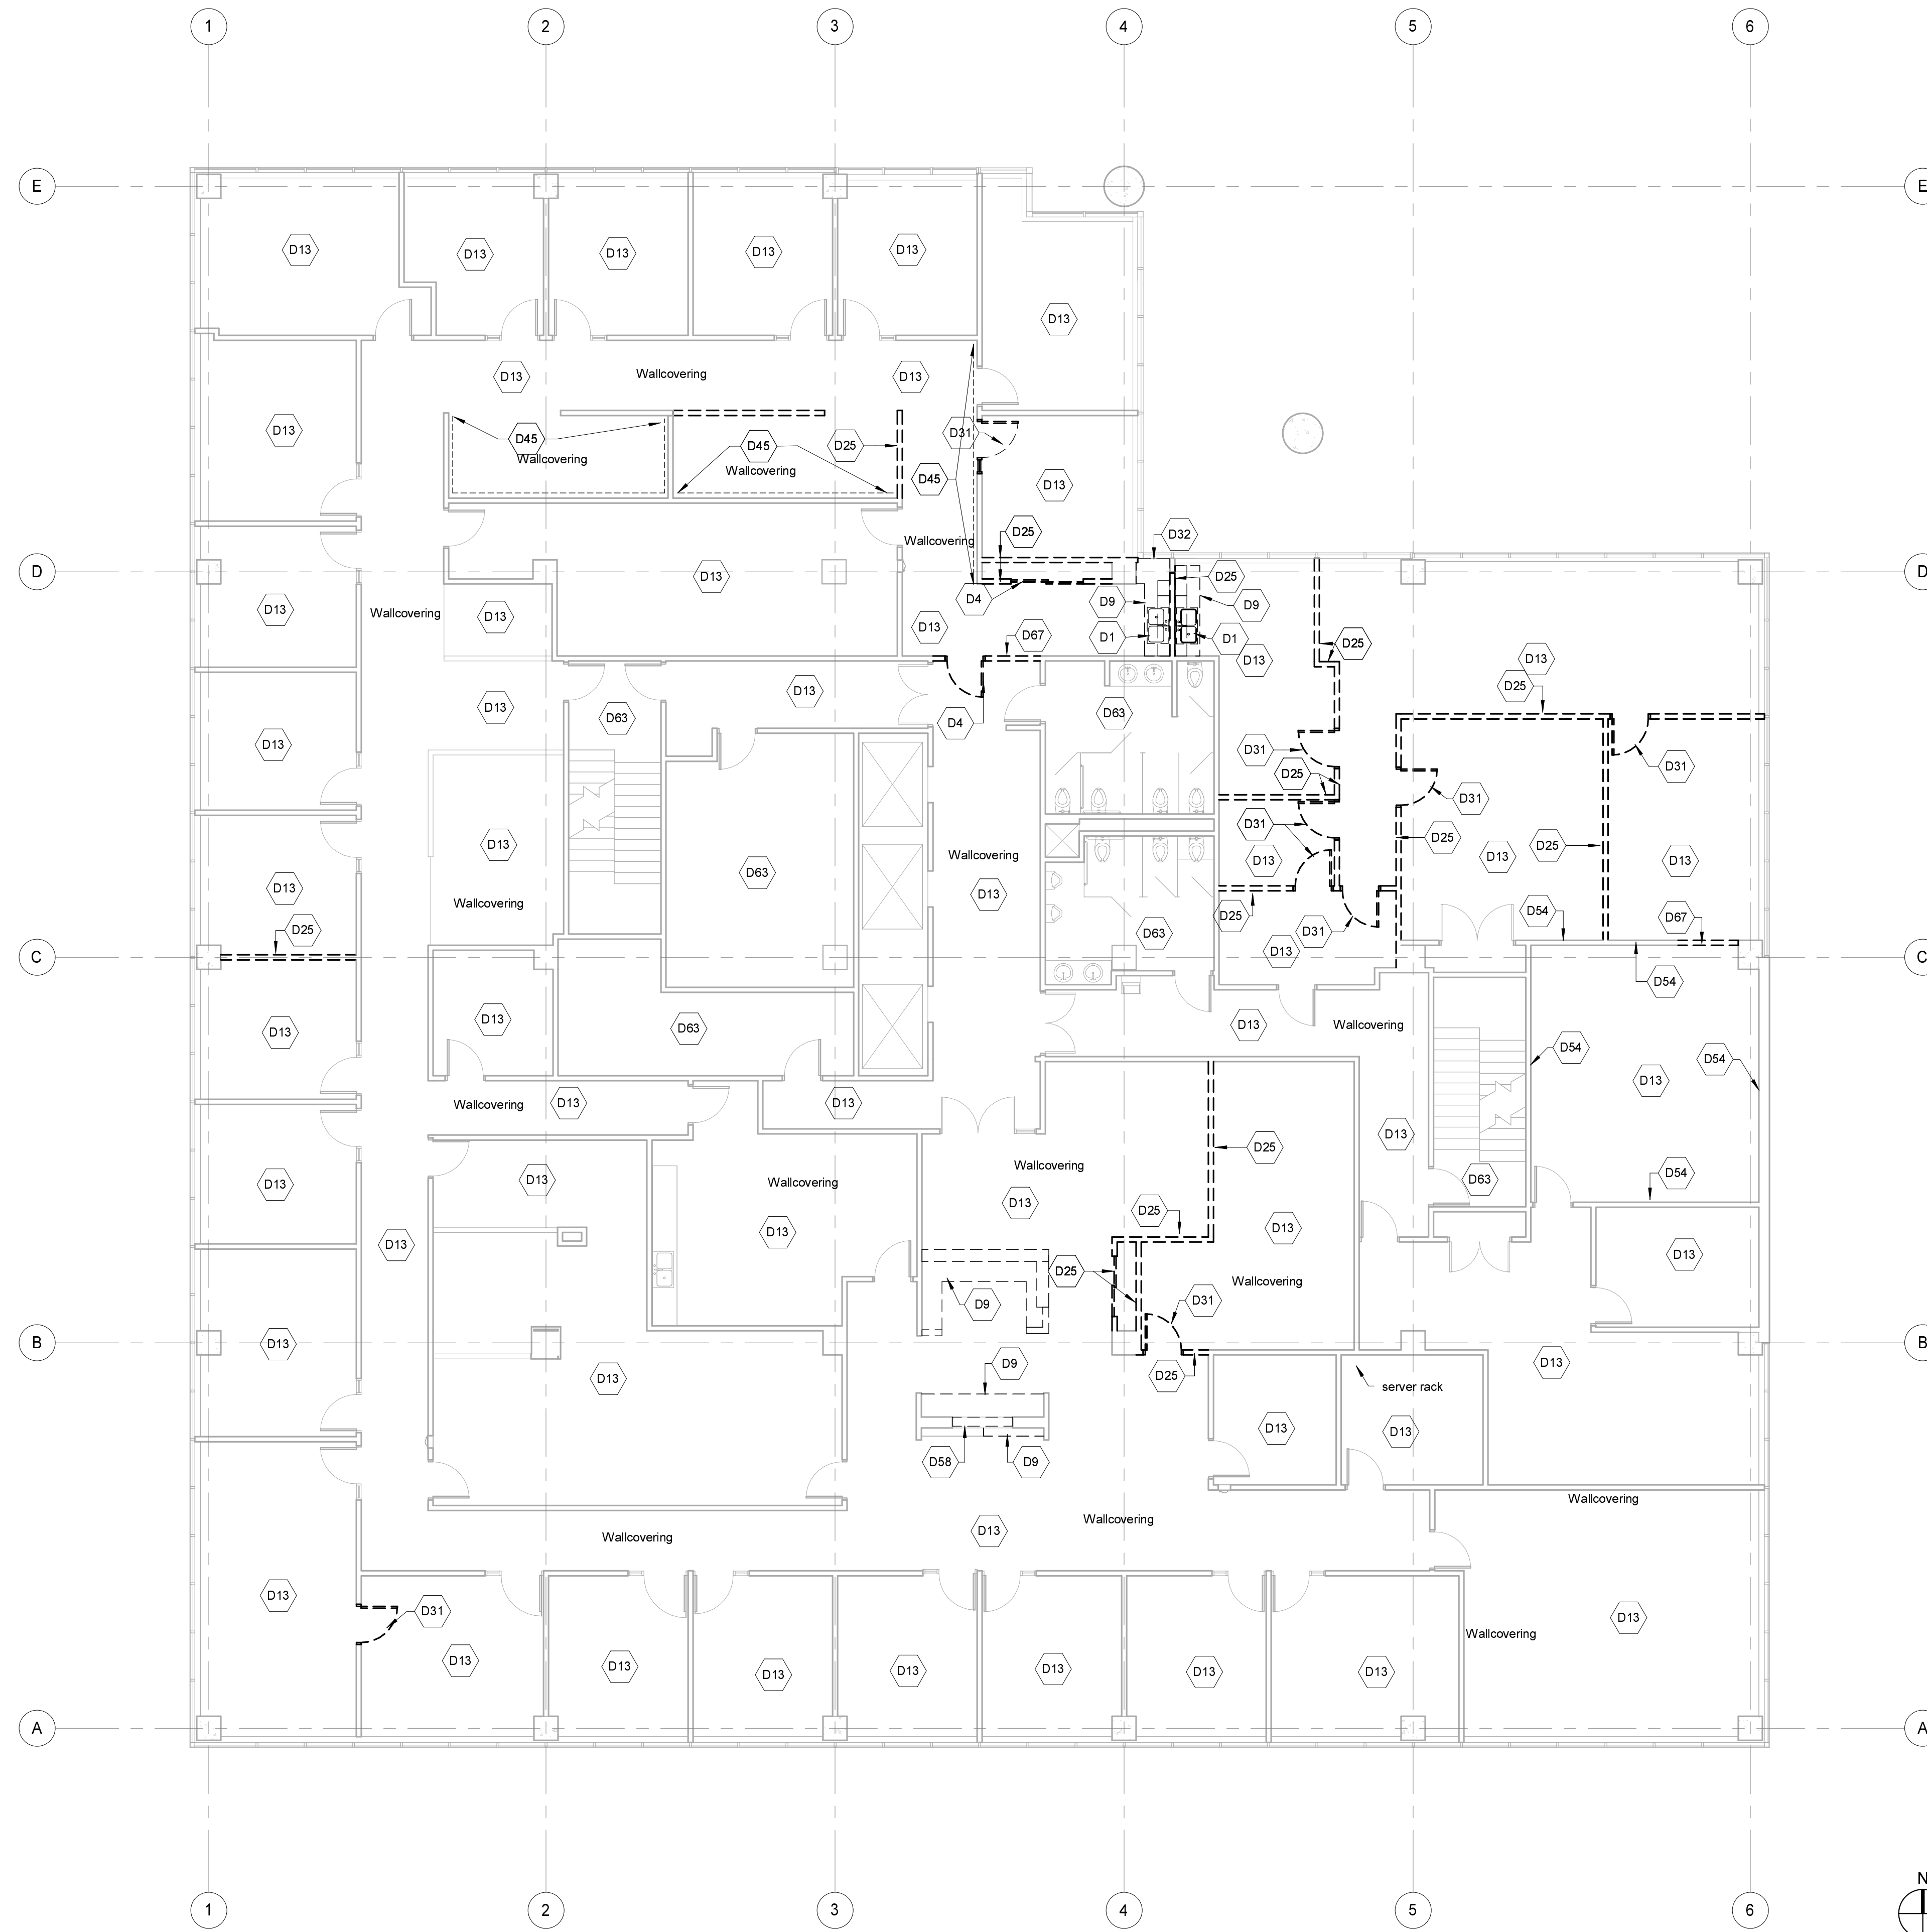


1 LEVEL 2 - DEMO PLAN
1/8" = 1'-0"

GENERAL DEMOLITION NOTES

- G.C. SHALL VERIFY ALL EXISTING SITE AND BUILDING CONDITIONS.
- COORDINATE WORK ON DEMO SHEETS WITH WORK ON FLOOR PLAN SHEETS - REF. MECH. AND ELEC. FOR CUT AND PATCH WORK.
- DASHED LINES REPRESENT ITEMS FOR REMOVAL OR RELOCATION - REF. KEYED NOTES.
- NOTES ON THIS SHEET ARE AN ACCUMULATION OF ITEMS ON ALL DEMOLITION PLAN SHEETS. NOT ALL ITEMS ARE FOUND ON EACH SHEET.
- CONTRACTOR SHALL HAVE FIRST SALVAGE RIGHTS ON ALL CONSTRUCTION RELATED ITEMS DESIGNATED TO BE REMOVED FROM FLOORS 1, 2, AND 3.
- CONTRACTOR SHALL CUT AND PATCH FLOORS, WALLS, CEILINGS, AND ROOFS AS REQUIRED FOR PLACEMENT OF NEW PIPING, CONDUITS, DEVICES, STRUCTURE, ETC. REF. ALL PLANS FOR LOCATIONS.
- G.C. SHALL PROTECT ALL STRUCTURAL ELEMENTS IN BUILDINGS TO REMAIN.
- G.C. SHALL VERIFY ALL NEW OPENINGS FOR PIPING, DUCTS, AND CONDUIT WITH THE EXISTING STRUCTURAL SYSTEM OF THE BUILDING. DO NOT CUT THROUGH CONCRETE FLOOR/ROOF BEAMS, CONCRETE FLOOR/ROOF JOISTS, CONCRETE COLUMNS, STEEL COLUMNS, OR STEEL ROOF JOISTS UNLESS NOTED ON THE PLANS.
- G.C. SHALL PROTECT ALL EXIST. BUILDING COMPONENTS AND FINISHES TO REMAIN. G.C. SHALL REPAIR DAMAGE CAUSED BY CONTRACTOR TO EXIST. BUILDING COMPONENTS & FINISHES TO REMAIN.
- CONTRACTOR SHALL PATCH, REPAIR AND PAINT ALL SURFACES RESULTING FROM DEMOLITION WORK. ALL PATCHES ARE TO MATCH ADJACENT FINISHES AS CLOSELY AS POSSIBLE. WALL OR FLOOR SURFACES WHERE MILLWORK, ELECTRICAL DEVICES OR MECHANICAL EQUIPMENT IS REMOVED SHALL BE PATCHED AND PAINTED.
- PROVIDE COVER PLATES OVER JOISTS WHICH ARE NO LONGER BEING USED. COLOR TO MATCH EXISTING. REMOVE ALL EXPOSED WIRE MOLD WHICH IS NO LONGER BEING USED. PATCH WALL.
- CONTRACTOR SHALL REMOVE ALL MECH./PLUMBING EQUIPMENT OR MATERIALS THAT ARE NOT RECONNECTED. SUCH ITEMS SHALL INCLUDE BUT ARE NOT LIMITED TO: VENT PIPING, WATER PIPES, HEATING WATER PIPES, CHILLED WATER PIPES, CONDENSATE DRAINS, SEWER LINES, GAS PIPES, INSULATION, DUCTWORK, ESCUTCHEONS, ELECTRICAL CONNECTIONS AND ASSOCIATED CONSTRUCTION EXPOSED TO VIEW.
- REFER TO MECHANICAL AND ELECTRICAL DEMOLITION SHEETS FOR ADDITIONAL INFORMATION ON MECHANICAL AND ELECTRICAL DEMOLITION WORK.
- REMOVE ALL FLOOR COVERINGS UNLESS OTHERWISE NOTED. FLOORING TO BE REMOVED SHALL BE REMOVED TO CONCRETE (OR EXIST. SUB-FLOOR STRUCTURE). ALL GLUE, GROUT, AND RESIDUE SHALL BE REMOVED TO PROVIDE A CLEAN BARE SURFACE.
- G.C. SHALL SALVAGE AND STOCKPILE BUILDING PRODUCTS FROM DEMOLITION TO BE USED FOR PATCHWORK. SUCH ITEMS SHALL INCLUDE BUT ARE NOT LIMITED TO WALL TILE, DOORS AND FRAMES, CEILING TILE, LIGHT FIXTURES, MECHANICAL DIFFUSERS, TRIM, SPECIAL EQUIPMENT, ETC.
- ALL TOILET ACCESSORIES SHALL BE REMOVED FROM RESTROOMS TO BE DEMOLISHED. G.C. SHALL VERIFY ITEMS TO BE SALVAGED.
- IN ROOMS WHERE NEW ACOUSTICAL CEILINGS ARE INSTALLED ABOVE ACOUSTICAL CEILINGS WHICH ARE REMOVED, PATCH WALL WHERE OLD ACOUSTICAL CEILING IS REMOVED.
- PLANK SILLS AT EXTERIOR WINDOWS TO REMAIN.
- CONDUCT WALKTHROUGH WITH OWNER TO VERIFY SIGNS TO REMAIN. REMOVE ALL OTHER SIGNS.
- PATCH HOLES IN WALL PRIOR TO PAINTING.
- REMOVE SIGNS PRIOR TO PAINTING. REINSTALL AFTER PAINTING.
- RESEAL SEAMS AT WALL COVERING WHERE GAPS OCCUR PRIOR TO PAINTING.
- REMOVE EXPOSED NAILS, SCREWS, ETC. AT WALLS AND PATCH BEFORE PAINTING.
- REMOVE WALL COVERING FROM ALL EXTERIOR WALLS AND HEADERS OF FLOORS 1-3, WHERE OCCURS. PRIOR TO PAINTING. REMOVE CEILING TILES WITHIN 2' MIN. OF WALL FOR OWNER INSPECTION PRIOR TO REINSTALLING CEILING TILES.
- WALLCOVERING TO REMAIN AT COLUMNS AND PLASTERS ABUTTING EXTERIOR WALLS AND AT ALL OTHER INTERIOR LOCATIONS UNLESS OTHERWISE NOTED.

KEYED DEMOLITION PLAN NOTES

- D1 REMOVE PLUMBING FIXTURES - REF. MECHANICAL.
- D4 REMOVE DOOR AND FRAME.
- D9 REMOVE EXISTING CASEWORK.
- D13 REMOVE EXISTING FLOOR COVERING AND BASE IN THIS AREA, PREP FOR NEW.
- D25 REMOVE EXISTING WALL.
- D31 REMOVE DOOR AND FRAME. SALVAGE FOR REUSE.
- D32 REMOVE WALL COVERING FROM HEADER. PREP FOR PAINT. REMOVE CEILING TILES WITHIN 2' MIN. OF WALL FOR OWNER INSPECTION PRIOR TO REINSTALLING CEILING TILES.
- D45 REMOVE WALL COVERING TO EXTENT SHOWN.
- D54 REMOVE CHAIR RAIL AND PREPARE WALL FOR PAINT.
- D58 REMOVE CUBBIES IN WALL AND INFILL WITH METAL STUDS AND GYP. BOARD.
- D63 ALL EXISTING FINISHES TO REMAIN AT THIS ROOM.
- D67 REMOVE EXISTING WALL UP TO 7'-2" AFF AND PATCH DRYWALL OPENING.

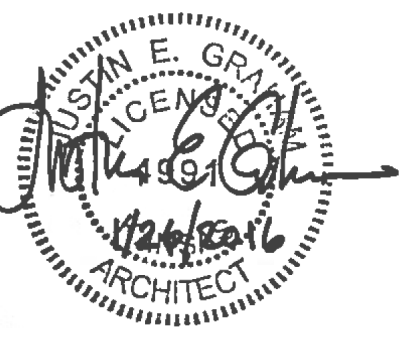

MIDWEST ENGINEERING, INC.
 MECHANICAL ENGINEERS
 GENUITY CONSULTING ENGINEERS
 ELECTRICAL ENGINEERS

271 BUILDING RENOVATION -
FLOORS 1,2,3
 SEDGWICK COUNTY
 271 W 3RD STREET, WICHITA, KANSAS 67202


©2015
 Schaefer Johnson Cox Fry Architecture, Inc.
 All Rights Reserved.
 These drawings and their contents, including, but not limited to, all concepts, designs, details and the exclusive property of Schaefer Johnson Cox Fry (SJCF), shall remain the property of SJCF and may not be used or reproduced in any way without the express consent of SJCF.

Revisions

Project Number	5119.23
Date	
26 JAN 2016	
2ND FLOOR	
DEMOLITION PLAN	

1/8" = 1'-0"

A21.2

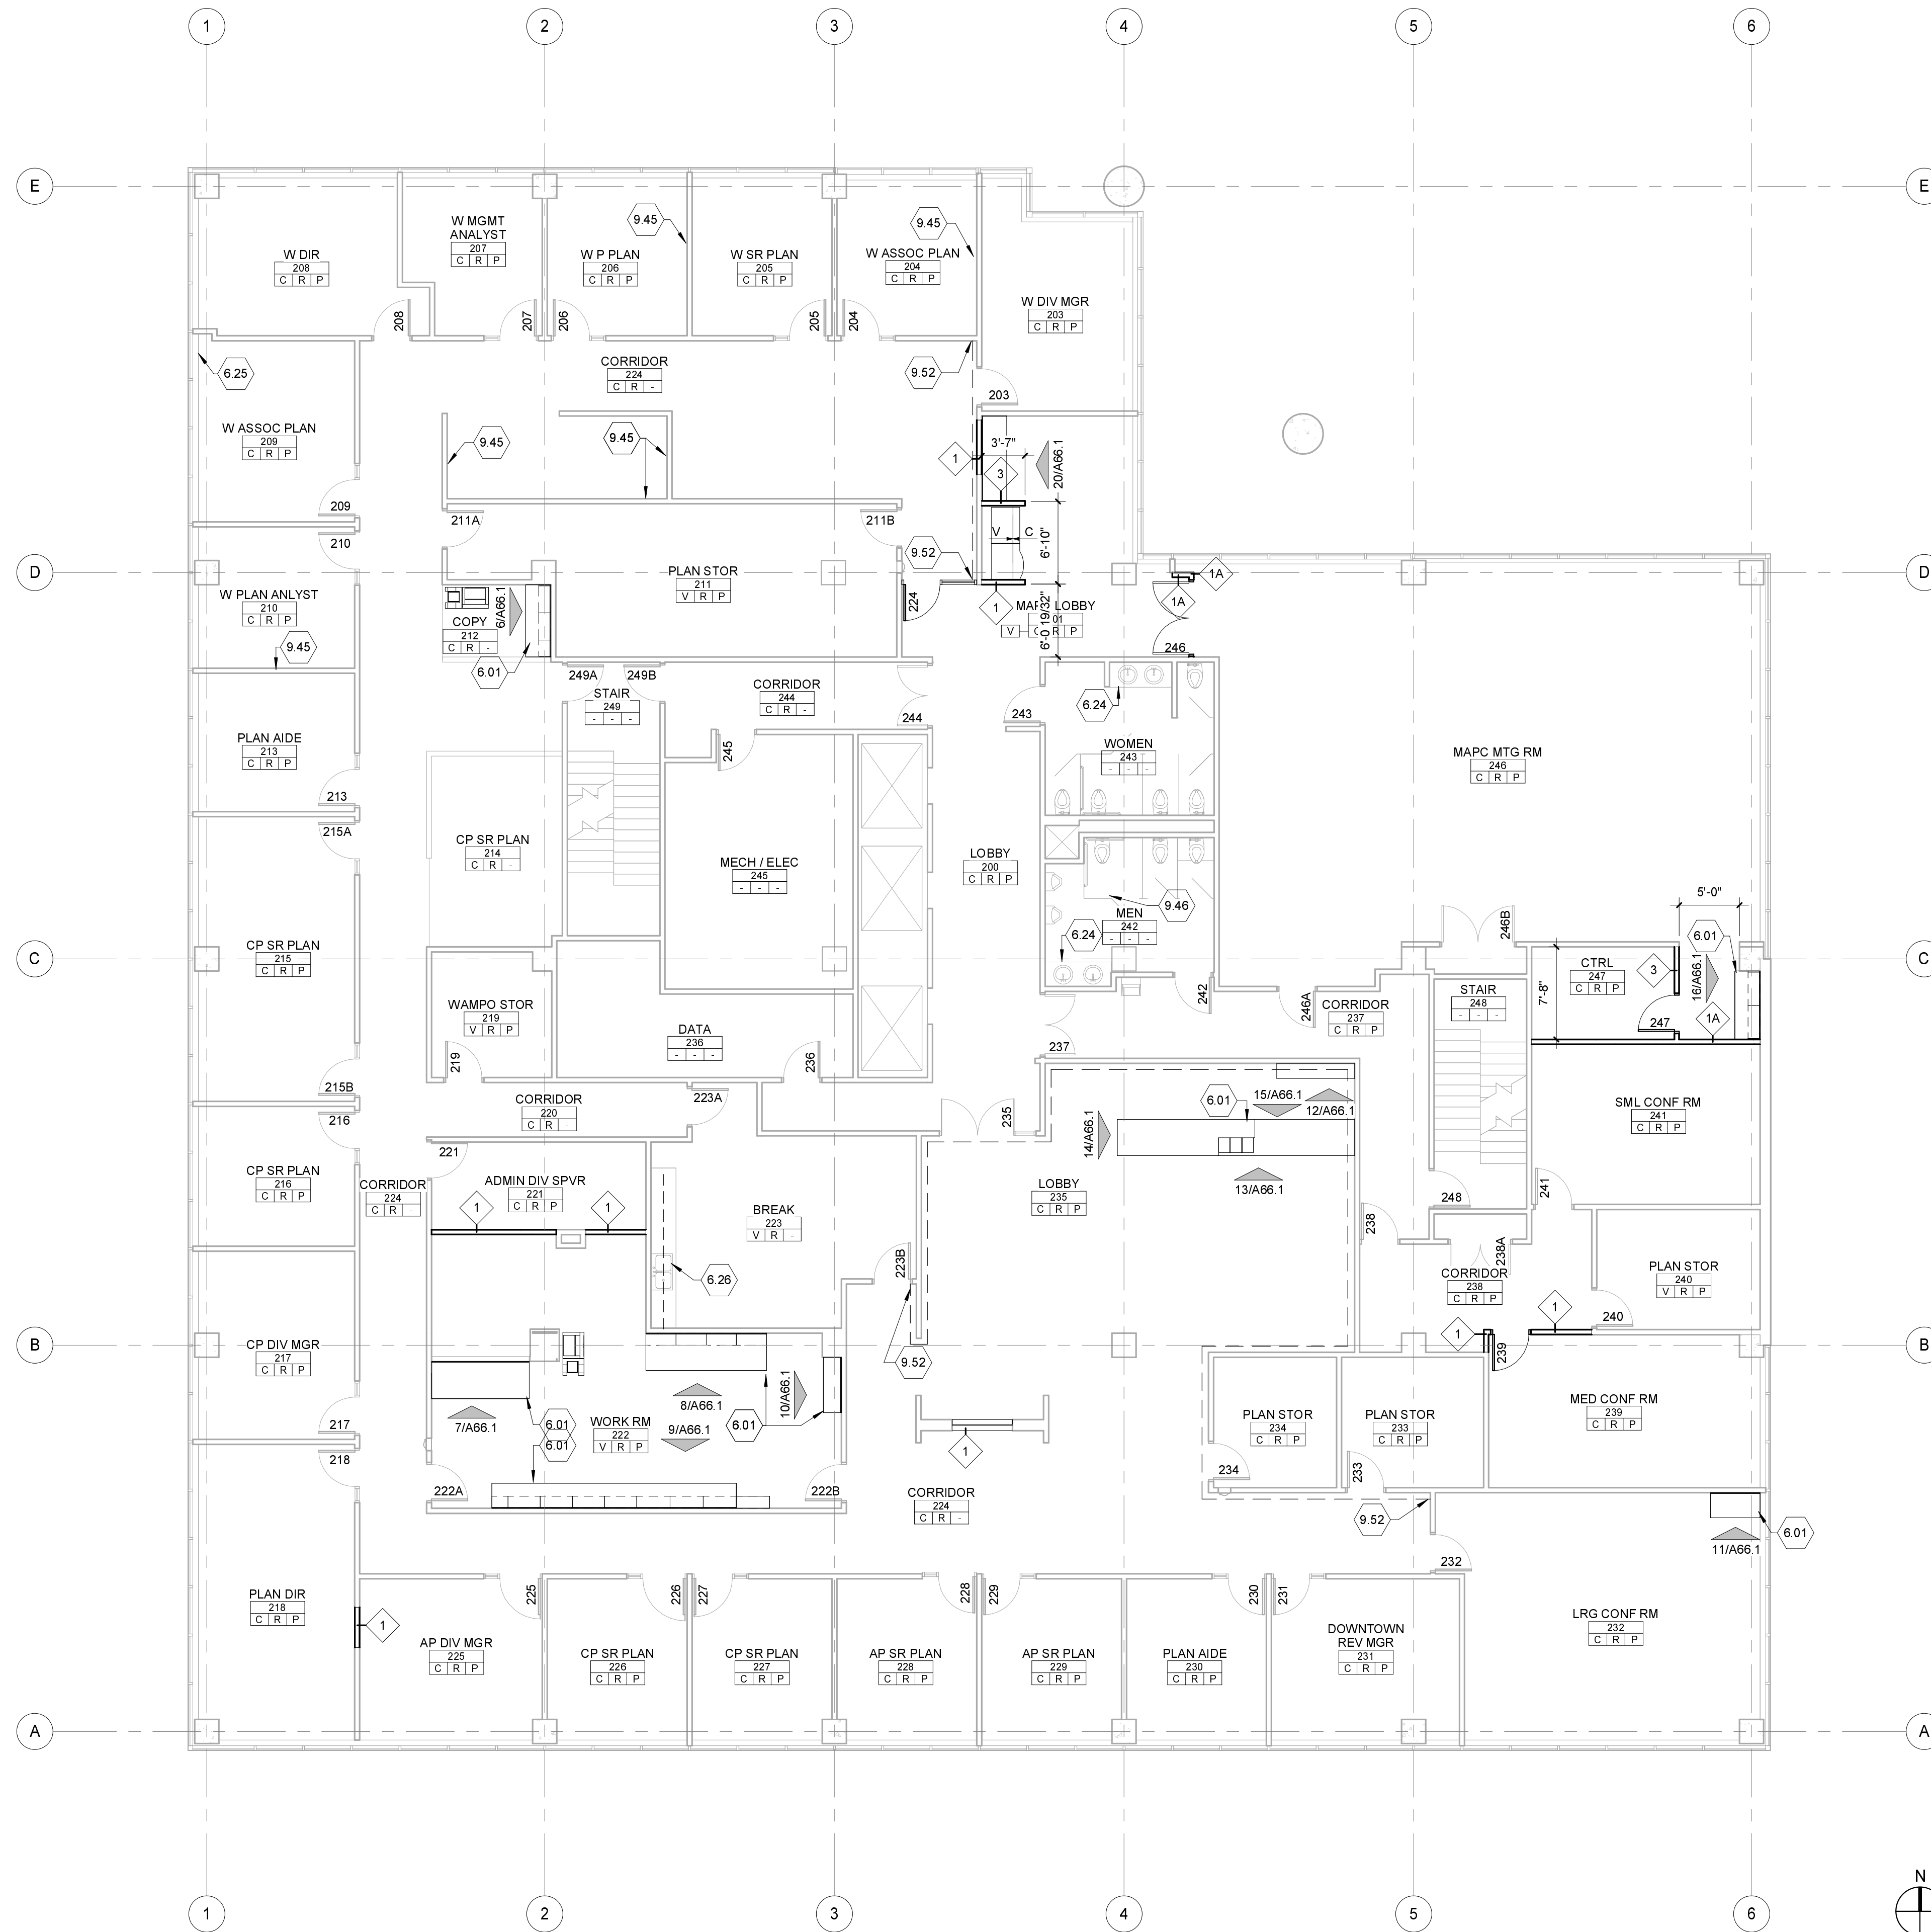

1 LEVEL 2 - PLAN
1/8" = 1'-0"

GENERAL NOTES

- CONTRACTOR TO VERIFY EXISTING SITE AND BUILDING CONDITIONS.
- WALL WITH DARK (BLACK) PERIMETER LINES INDICATE NEW WALLS.
- EXISTING WALLS SHOWN WITH SCREENED (GRAY) LINES WITH NO FILL.
- PLAN DIMENSIONS ARE TO FACE OF STUD, TYP AND FROM FACE OF FINISHED EXISTING WALL WHERE OCCURS.
- SEE ALL MILLWORK DETAILS FOR ALL CASEWORK GOODS THAT REQUIRE IN-WALL BLOCKING FOR ATTACHMENT.
- RESEAL GAPS AT SEAMS IN WALLCOVERING WHERE OCCURS, PRIOR TO PAINTING.
- CLEAN INTERIOR SIDE OF CLEAN EXTERIOR WINDOW FRAMES AND GLASS.
- FILL ALL HOLES IN WALLS PRIOR TO PAINTING.
- RELOCATE SPRINKLER HEADS FOR NEW WALL LAYOUTS AND FINISH CEILING CHANGES IN ACCORDANCE WITH IBC 903.3.1.1 SPRINKLER SYSTEM TO BE FULLY TESTED AND INSPECTED BY ALL GOVERNING JURISDICTIONS.
- ABBREVIATIONS:
 - CJ CONTROL JOINT - REF. DETAIL
 - FEC FIRE EXTINGUISHER AND CABINET - REF. SPEC.
 - MB MARKER BOARD
 - TB TACKBOARD
 - PS PROJECTION SCREEN - REF. SPEC.
 - FE FIRE EXTINGUISHER AND BRACKET - REF. SPEC.
 - NIC NOT IN CONTRACT, ITEM FURNISHED BY OWNER
 - VIF VERIFY IN FIELD ACTUAL CONDITIONS

KEYED FLOOR PLAN NOTES


- 6.01 MILLWORK - REF. A66 SERIES SHEETS & SPECIFICATIONS.
- 6.24 CLEAN AND RECAULK COUNTERTOP AND APRON.
- 6.25 REGULUE EDGE ON WINDOW SILL.
- 6.26 REGULUE EDGE BAND AT TRASH OPENING.
- 9.45 PATCH WALL AND PREPARE FOR PAINT.
- 9.46 REPAIR BUBBLE IN FLOOR TILE.
- 9.52 PAINT WALLCOVERING TO THE EXTENT SHOWN.

FINISH SCHEDULE GUIDE

FLOOR:	BASE:	WALL:
C CARPET	C CERAMIC TILE	C CERAMIC WALL TILE
M WALKOFF CARPET	R RUBBER BASE	E EPOXY PAINT
T MOSAIC PORCELAIN TILE	NO FIN. REQ./EXISTING	P PAINT
U PORCELAIN TILE	FINISH TO REMAIN IN 'AS-IS' CONDITION	F FIBERGLASS REINFORCED PANEL
V VINYL TILE	NO FIN. REQ./EXISTING	NO FIN. REQ./EXISTING
NO FIN. REQ./EXISTING	FINISH TO REMAIN IN 'AS-IS' CONDITION	FINISH TO REMAIN IN 'AS-IS' CONDITION

ROOM NAME	ROOM NUMBER	WALL FINISH	BASE MATERIAL	FLOOR FINISH
1	1	1	1	1

- REFER TO A6 SERIES SHEETS FOR CHANGES IN FLOOR FINISH DETAILS.
- REFER TO DOOR AND FRAME SCHEDULE FOR EXISTING HW FRAMES TO BE PAINTED.
- BASE BID - PAINT OVER EXISTING WALL COVERING WHERE NEW PAINT IS SCHEDULED, EXCEPT WHERE WALLCOVERING IS SPECIFICALLY NOTED TO BE REMOVED. FILL HOLES IN WALLS PRIOR TO PAINTING.
- ALTERNATE #1 - REMOVE EXISTING WALLCOVERING PRIOR TO PAINTING, WHERE PAINT IS SCHEDULED. REFER TO DEMO PLANS FOR EXISTING WALLCOVERING LOCATIONS.

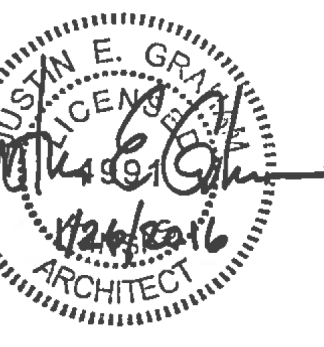

Revisions

Project Number
5119.23

Date

26 JAN 2016
2ND FLOOR PLAN

1/8" = 1'-0"

A22.2